


US1, US2 & US3 Connectors

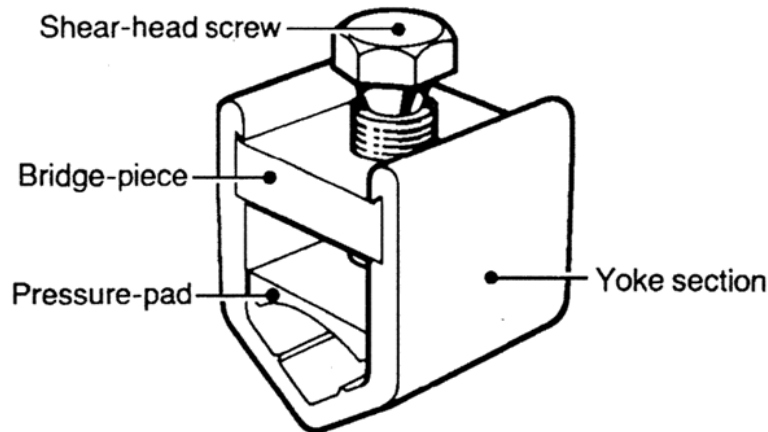

Principle Application

Stranded service connections from stranded sector shaped mains conductors.

Range

| Connector Reference | Core c.s.a. (mm ²) | | | Approx Unit Wt. (gms) |
|---------------------|--------------------------------|------|---------|-----------------------|
| | Mains | | Service | |
| | min. | max. | max. | |
| US1 | 50 | 95 | 35 | 55 |
| US2 | 120 | 185 | 50 | 83 |
| US3 | 185 | 300 | 50 | 135 |


The Hepworth US range of service branch connectors has been designed to connect stranded circular or sector shaped services to three or four core stranded sector shaped mains conductors in the ranges specified above.

Ease of fitting and simplicity of use were fundamental objectives adopted in the design of this range of connectors, and the Hepworth shear head screw principle ensures that a reliable and consistent connection is achieved without the need for specialised tooling.

Each connector is supplied in a sealed pack together with fitting instructions, details of which are included in the technical data overleaf.

US1, US2 & US3 Connectors

Physical Dimensions

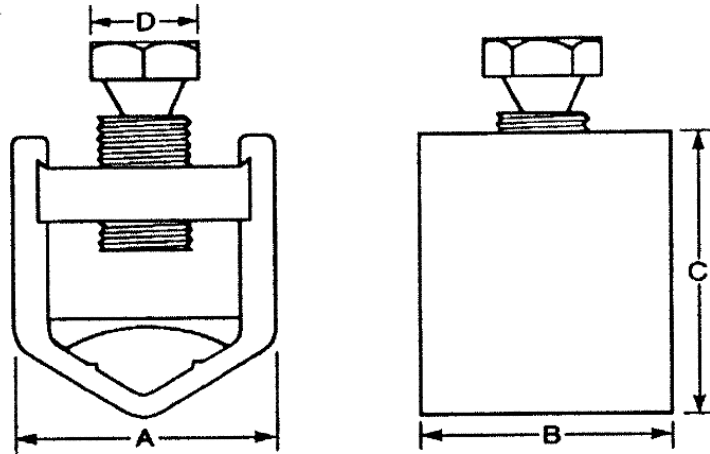

| Ref code | DIMENSIONS (mm) | | | |
|----------|-----------------|----|----|----|
| | A | B | C | D |
| US 1 | 26 | 25 | 40 | 17 |
| US 2 | 31 | 30 | 44 | 17 |
| US 3 | 42 | 40 | 53 | 17 |

Material

Aluminium Alloy.

Fitting Instructions

Separate the main cable cores sufficiently to allow the yoke section to be fitted around the conductor and strip the insulation from the core equal to the connector length plus 5mm. Cut the service conductor to length, strip the insulation to suit, then separate the individual strands and splay out to form a single layer that will spread out over the back radius of the mains conductor.

Loosely assemble the connector around the cores by inserting the bridge piece and locating the pressure pad over the splayed out service strands, then tightening the shear head screw until positive location is achieved. Check for even distribution of the service strands then finally tighten the screw until the head shears.

If copper conductors are to be jointed they should be wrapped in brass gauze. In case of a copper service conductor being jointed onto a stranded aluminium main, care must be taken to ensure that the individual strands of the service conductor are spread out in the fashion described above within the wrap of the brass gauze. All conductors must be thoroughly abraded.