



Distribution Shrink-Fit Terminations

Elastimold® Ranger2® Terminations

- Silicone polymer housing provides superior memory and weathering characteristics
- Shrink-fit housing uses common installation procedures and cable preparation dimensions, and field-removable center core allows for easy installation
- Three different shed designs for superior weathering:
 - Four sheds for 15kV outdoor model
 - Six sheds for 25/28kV outdoor model
 - Eight sheds for 35kV outdoor model
- Three sizes cover entire cable range from #2 AWG to 1250 kcmil
- Units accommodate popular XLP and EPR cable types and various shield constructions
- Integral Hi-K Voltage stress-control tube provides uniform voltage grading over the length of the termination and eliminates damaging voltage stress concentrations at the cable insulation shield edge
- Thick wall construction securely maintains critical interface pressure for consistent long-term reliability and performance
- Pull-down tabs for easy installation of built-in jacket seal — accommodate CN, JCN, Tape, Wire or LC shielded cable construction
- Lightweight, compact design installs in restricted spaces and permits application where free hanging is desired
- Dark gray molded silicone insulator utilizes specially formulated silicone materials with improved UV stability, track, erosion and weather resistance for enhanced performance under the worst environmental conditions
- Optional connectors with copper stem and one-hole or two-hole spade
- Optional cable and support bracket with three sizes ranging from .80"–2.40" O.D.


Silicone Polymer Housings

The R2T and R2IT terminations are manufactured using an optimized weather-resistant silicone formulation. The housing offers superior cable sealing and voltage withstand characteristics.

Elastimold® terminations meet or exceed all requirements of IEEE 48 for Class 1 outdoor or Class 2 indoor terminations. Unit tests include voltage withstand wet and dry, before and after load cycling on units installed on maximum conductor sized cable.

Kit Contents

Every R2T and R2IT comes complete with housing and stress tube preassembled on the core, ready for installation. Easy-to-read installation instructions will take you from cable preparation through installation. All kits include a tube of silicone grease, two plastic gloves and two strips of self-fusing silicone tape. Outdoor kits also include mastic for sealing. Metallic Tape (M) kits include a grounding adapter for Tape Shield, Wire Shield and UniShield cables. LC Shield (L) kits include a high-ampacity grounding adapter for Longitudinally Corrugated Shield, Tape Shield and Wire over Tape Shield cables.

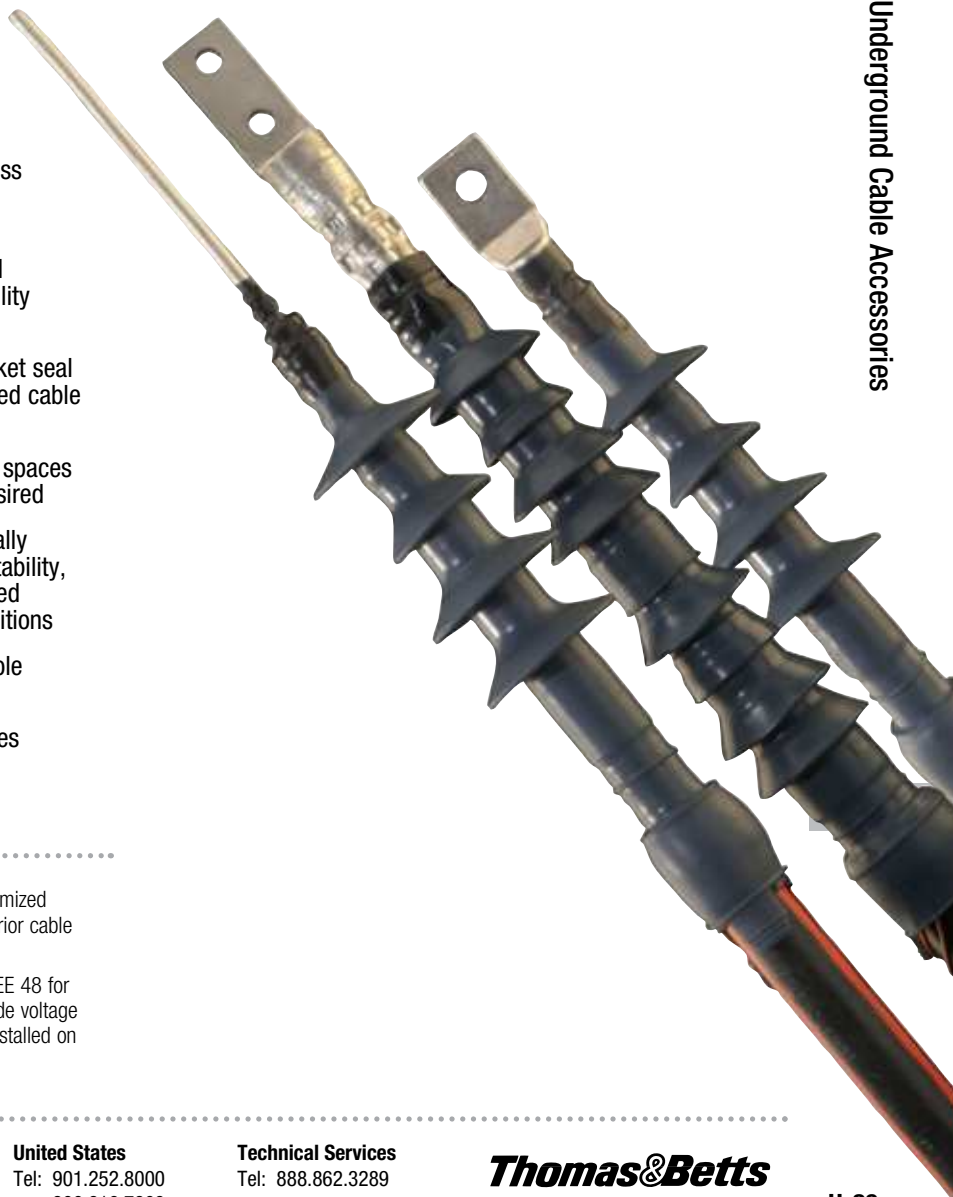


Distribution Shrink-Fit Terminations

Stress Relief

The R2T and R2IT terminations provide electric stress control for the cable by means of a flexible tube with a high-permittivity dielectric constant.


The stress-relief tube is preassembled on the core under the polymer housing. As the core is removed, the stress-relief tube and housing shrink onto the cable at the same time, in exactly the right position. No secondary operations are required during installation. The electrical fields are refracted through the high-dielectric constant tube and housing as shown.

Voltage Stress

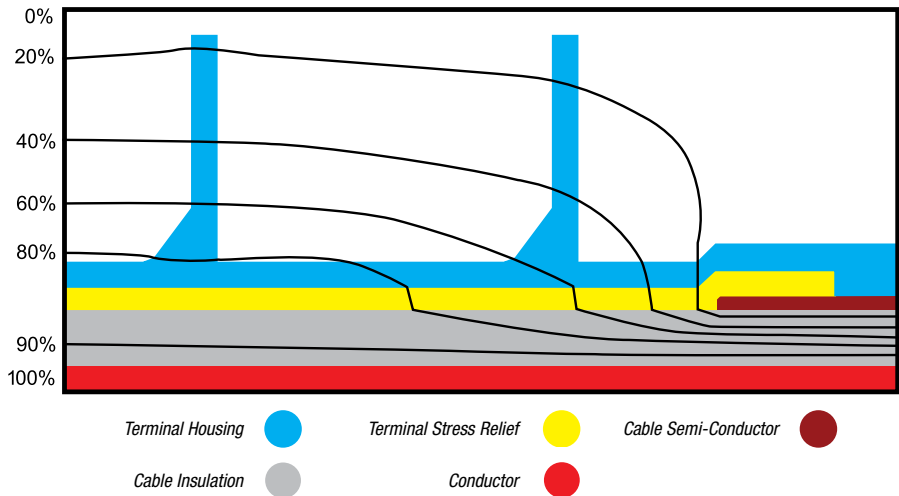

Installation

Standard cable preparation techniques are used for all R2T Elastimold® Ranger2® Outdoor Terminations and R2IT Elastimold® Ranger2® Indoor Terminations. The Elastimold® shrink-fit terminations are assembled on a removable core. After the termination is placed onto the prepared cable, the core is removed by pulling on the end. The housing then collapses onto the prepared cable. Memory of the material provides the interface solid dielectric and sealing properties required to meet the electrical ratings and prevent the ingress of moisture.

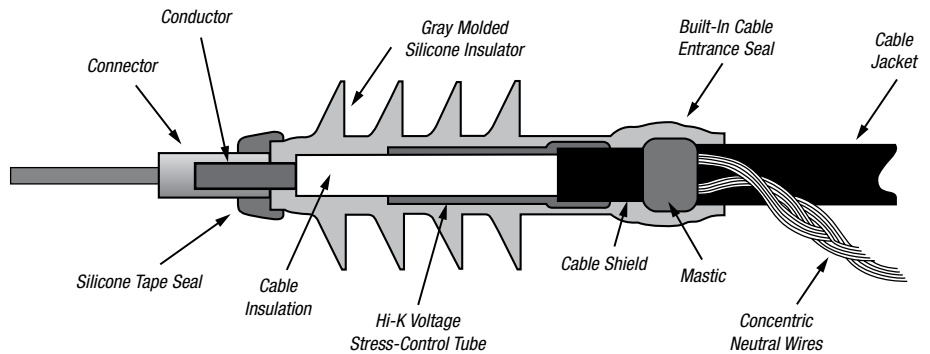

Certified

Elastimold® Ranger2® Terminations have been designed and tested per applicable portions of ANSI, IEEE, AEIC, ICEA and other industry standards.

IEEE 48

Standard for indoor and outdoor cable terminations.

ANSI C119.4

Standard for cable connectors for aluminum and copper conductors.

AEIC CS8-06 & ANSI/ICEA S-94-649-2004 & S-97-682-2000

Standards for XLP and EPR insulated cables.

Distribution Shrink-Fit Terminations

Ratings

	R2T15 INDOOR	R2T15 OUTDOOR	R2T28 OUTDOOR	R2T35 OUTDOOR
Sizes Available*	1, 2, 4	1, 2, 4	2, 4	2, 4
Voltage Rating (kV)	15	15	25/28	35
Max. Design Voltage to Ground (kV)	9.5	9.5	16	22
Corona Extinction Voltage (kV) (≤ 3 p.c.) (Partial Discharge)	13	13	22	30
Insulation Withstand Voltage:				
Lightning Impulse (BL Dry 110 Withstand) (kV Crest)	110	110	150	200
10 Sec. Wet (60 Hz) (kV)	—	45	60	80
1 Minute Dry (60 Hz) (kV)	50	50	65	90
5 Hour Dry (60 Hz) (kV)	35	35	55	75
DC Withstand 15 Min. Dry (kV)	75	75	105	140

Application Information

IEEE 48 Classification	Outdoor = Class 1A, Indoor = Class 2
Ambient Temperature Range	-30° C to 65° C
Power System Frequency	48 to 62 Hz
Altitude Range	3,300 feet max.
Mounting	Free hanging or optional bracket

Dimensions

	R2T15 INDOOR	R2T15 OUTDOOR	R2T28 OUTDOOR	R2T35 OUTDOOR
Sizes Available*	1, 2, 4	1, 2, 4	2, 4	2, 4
Voltage Rating (kV)	15	15	25/28	35
Number of Sheds	0	4	6	8
Minimum Strike Distance in. (mm)	8.4 (213)	11.6 (295)	14.5 (368)	16.8 (427)
Creepage Distance in. (mm)	8.4 (213)	15.0 (381)	22.8 (579)	30.0 (762)

* See **page H-32** for cable insulation diameter ranges.

Distribution Shrink-Fit Terminations

Ranger2® Terminations

The R2T and R2IT termination design couples shrink-fit technology and Elastimold's pull-down jacket seal feature to provide a termination line that covers the widest range of applications with the fewest number of models. Three sizes cover .64" (16mm) to 2.10" (53mm) insulation diameter cables (#2 AWG through 1250 kcmil).

The R2T housings are designed for maximum performance in all field conditions with superior creepage and strike distances for long-term service. Insulating silicone sleeves are also available when more creepage is required or when wildlife protection is needed to insulate the connectors. Contact your Thomas & Betts Sales Representative for further information.

Ranger2® Terminations Base Catalog Numbers

	KV CLASS	TYPE	CABLE RANGE (INSULATION DIAMETER)		CAT. NO.		
			INCHES	MM	CONCENTRIC NEUTRAL & JACKETED CONCENTRIC NEUTRAL CABLE	TAPE SHIELD, WIRE SHIELD & UNISHIELD CABLE	LC SHIELD, WIRE OVER TAPE SHIELD & TAPE SHIELD CABLE
	15	Indoor	.64 to 1.12	16.3 to 28.4	R2IT15J1	R2IT15M1	R2IT15L1
			.84 to 1.38	21.3 to 35.1	R2IT15J2	R2IT15M2	R2IT15L2
			1.30 to 2.10	33.0 to 53.3	R2IT15J4	R2IT15M4	R2IT15L4
	15	Outdoor	.64 to 1.12	16.3 to 28.4	R2T15J1	R2T15M1	R2T15L1
			.84 to 1.38	21.3 to 35.1	R2T15J2	R2T15M2	R2T15L2
			1.30 to 2.10	33.0 to 53.3	R2T15J4	R2T15M4	R2T15L4
	25/28	Outdoor	.84 to 1.38	20.3 to 35.1	R2T28J2	R2T28M2	R2T28L2
			1.30 to 2.10	33.0 to 53.3	R2T28J4	R2T28M4	R2T28L4
	35	Outdoor	.84 to 1.38	20.03 to 35.1	R2T35J2	R2T35M2	R2T35L2
			1.30 to 2.10	33.0 to 53.3	R2T35J4	R2T35M4	R2T35L4

Distribution Shrink-Fit Terminations

Ranger2® Termination Connector Options

	TYPE	MATERIAL	CONDUCTOR	CONDUCTOR SIZE	CONNECTOR PREFIX*
	Stem Compression Connector	Aluminum	Aluminum or Copper	#2 through 4/0 (34–107mm ²)	T0
		Aluminum	Aluminum Only	#2 through 4/0 (34–107mm ²)	T1
	One-Hole Spade Connector	Tinned Aluminum	Aluminum or Copper	#2 through 500 kcmil (34–253mm ²)	H0
	Two-Hole Spade Connector	Tinned Aluminum	Aluminum or Copper	#2 through 1250 kcmil (34–633mm ²)	N0
		Tinned Copper	Copper	#2 through 1250 kcmil (34–633mm ²)	N2

* See **page H-34** for Conductor Code.

Optional Cable Support Brackets

Ranger2® Terminations are compact, lightweight and frequently allow use of free-hanging mounting methods. Optional cable support brackets are available if required.

TYPE	CABLE RANGE (OVERALL O.D.)	PLATED MILD STEEL		STAINLESS STEEL	
		CAT. NO.	SUFFIX NUMBER	CAT. NO.	SUFFIX NUMBER
	Single Clamp .80"–1.25" (20–32mm)	JB-1	B1	JB-5	B5
	Single Clamp 1.10"–1.50" (28–38mm)	JB-2	B2	JB-6	B6
	Double Clamp 1.45"–1.95" (37–50mm)	JB-3	B3	JB-7	B7
	Double Clamp 1.80"–2.40" (45–61mm)	JB-4	B4	JB-8	B8

Add-on Grounding Kits

Convert a jacketed concentric neutral "J" kit to an "M" or "L" shield kit.

	CAT. NO.	TYPE	SIZE	USE WITH SERIES
	GMA	Tape Shield/Wire Shield/UniShield	A	R2IT15J1, R2IT15J2, R2T15J1, R2T15J2, R2T28J2, R2T35J2
	GMB	Tape Shield/Wire Shield/UniShield	B	R2IT15J4, R2T15J4, R2T28J4, R2T35J4
	GLA	LC Shield/Wire over Tape Shield	A	R2IT15J1, R2IT15J2, R2T15J1, R2T15J2, R2T28J2, R2T35J2
	GLB	LC Shield/Wire over Tape Shield	B	R2IT15J4, R2T15J4, R2T28J4, R2T35J4


Distribution Shrink-Fit Terminations

Ordering Information for Ranger2® Terminations

Ranger2® Terminations may be ordered in components or as complete kits by following the steps outlined and using the model below to develop the catalog number for your application. Contact your local Thomas & Betts Sales Representative for special requirements.

The following diagram shows how to construct a catalog number for a Ranger2® Termination.

Indicates field that must be filled in to complete order.
Note: Availability of selected configuration will be verified at quotation time.

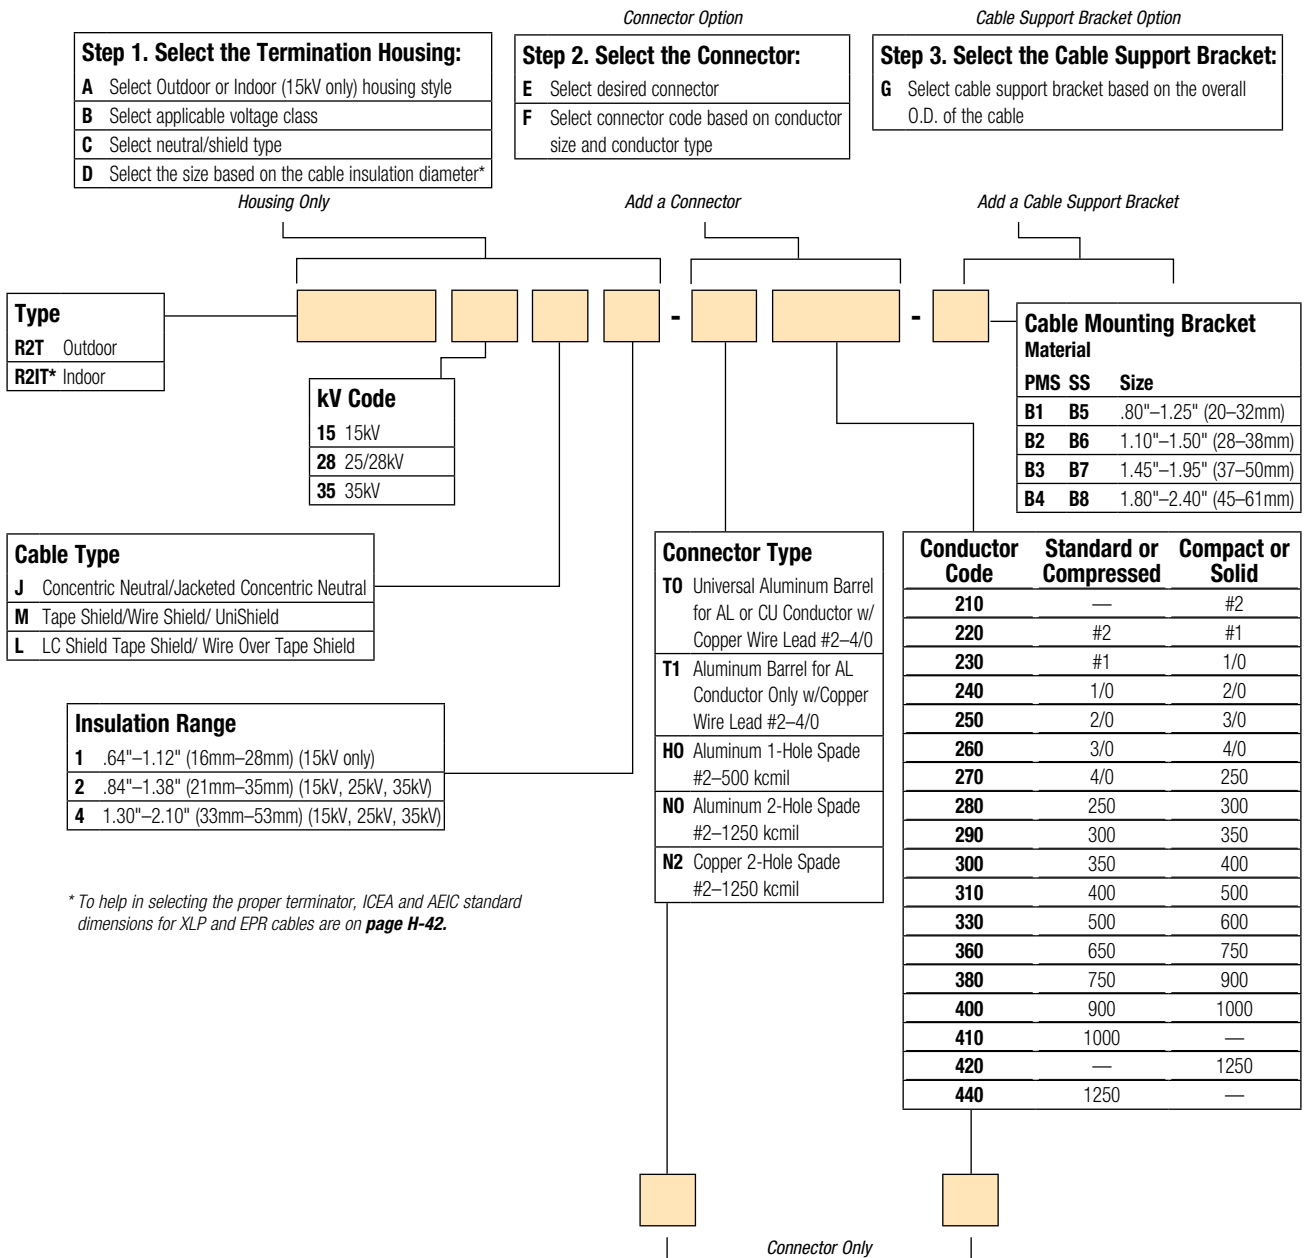

* To help in selecting the proper terminator, ICEA and AEIC standard dimensions for XLP and EPR cables are on [page H-42](#).

Distribution Shrink-Fit Terminations

Typical Installation of Elastimold Shrink-Fit Terminations (R2T — Outdoor and R2IT — Indoor)



1. Train the cable into position and cut to length. Using standard practices, cut back the cable jacket, metallic shield, semi-conductive shield and cable insulation, exposing the conductor.



5. Apply a liberal bead of silicone lubricant to the semi-con shield step.



6. Pull the loose end of the core cord until the core is even with the end of the termination housing.



7. Position the terminator onto the cable.

2. Finish preparing the metallic shield. For concentric neutral or jacketed concentric neutral cables, bend back the neutral wires and seal with mastic strips and vinyl tape. For metallic tape, drain wire, UniShield or LC Shield cables: install the ground braid using the constant force spring and seal with mastic strips and vinyl tape.



8. Shrink into place by unwinding the removable core.



9. Apply silicone lubricant to skirt and mastic area.

3. Clean the exposed conductor, install and crimp the connector.


4. Use mastic and vinyl tape to fill any gap or step between the connector and the cable insulation. Clean the cable.



10. Fold down the skirt over the mastic to seal the cable entrance.



11. Seal the top of the terminator at the connector area with silicone tape.

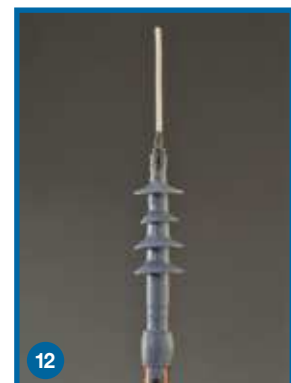

12. Attach the neutral wires or optional ground braid to the system ground per local code. Install the optional cable support bracket if required.