Data sheet

Surge arrester POLIM-H..SD



Product description

Surge arrester with metal-oxide resistors without spark gaps (MO surge arrester), direct molded silicone housing, grey color, designed and tested according to EN 50526-1 and IEC 62848-1.

The metal-oxide resistors are from own production line.

Overvoltage protection of

- Traction systems fixed installations
- Rolling stock
- Equipment in direct current installations

Application

- Systems with direct current (DC)
- Outdoor and indoor installations

Additional certification

- Shock and vibration tested according to IEC 61373
- Fire and smoke behaviour tested and classified according to EN 45545-2

Technical data

Classification according to EN 50526-1 and IEC 62848-1

Nominal discharge current In (8/20 µs)	10 kA _{peak}
Class	DC-B
High current impulse I _{hc} (4/10 μs)	100 kA _{peak}
Switching current impulse I _{sw} (30/60 µs)	1000 A _{peak}
Charge transfer capability Q _t	2.5 As
Energy withstand capability W	9.5 kJ/kV _{Uc}
Short circuit rating I _s	40 kA DC for 0.2 s

The thermal stability of the MO surge arrester is proved in the operating duty test according to class DC-B with two impulses of the charge transfer capability Q_t (total 5 As).

Classification according IEC 60099-4

Arrester class	SH, Station High
Line discharge class (LD)	4
Nominal discharge current I _n (8/20 μs)	20 kA _{peak}
Repetitive charge transfer rating Q _{rs}	2.4 As (C)
Long duration current impulse	1350 A for 2000 µs

Mechanical loads

Torque	50 Nm
Tensile strength axial	1000 N
Short term load SSL perpendicular to axis	225 Nm
Long term load SLL perpendicular to axis	180 Nm

Service conditions

Ambient air temperature T _{amb}	−60 to +40 °C
	(for temperatures up to 80°C
	consider instructions
	of application guidelines)
Altitude	up to 1800 m
	(for higher altitudes contact
	manufacturer)



THORNE & Derrick
DERRICK +44 (0) 191 410 4292
INTERNATIONAL www.powerandcables.com

Electrical data


U _c (= U _r) *	Residua	Residual voltage $U_{\rm res}$ at specified impulse current									
Continuous	Steep ci	urrent	Lightning current impulse					Switching current impulse wave 30/60 µs			
operating	impulse		wave 8/20 μs								
voltage	wave 1/µs										
	5 kA	10 kA	1 kA	2 kA	5 kA	I _n =10 kA	20 kA	250 A	500 A	1000 A	
kV DC	kV_{peak}	kV_{peak}	kV_{peak}	kV _{peak}	kV_{peak}	kV_{peak}	kV _{peak}	kV_{peak}	kV _{peak}	kV_{peak}	
).14	0.35	0.38	0.30	0.32	0.33	0.34	0.38	0.28	0.29	0.30	
).29	0.72	0.77	0.61	0.64	0.68	0.70	0.77	0.58	0.60	0.61	
0.36	0.88	0.94	0.75	0.79	0.83	0.86	0.94	0.71	0.73	0.75	
).49	1.20	1.28	1.02	1.07	1.13	1.17	1.28	0.96	0.99	1.02	
0.56	1.37	1.47	1.17	1.23	1.29	1.34	1.47	1.10	1.14	1.17	
0.85	2.08	2.22	1.77	1.86	1.95	2.03	2.22	1.67	1.72	1.77	
1.0	2.43	2.60	2.08	2.18	2.29	2.38	2.60	1.96	2.01	2.07	
1.5	3.65	3.90	3.11	3.26	3.43	3.57	3.90	2.93	3.02	3.10	
2.0	4.86	5.19	4.15	4.35	4.57	4.76	5.19	3.91	4.02	4.14	
2.5	6.07	6.49	5.18	5.44	5.71	5.95	6.49	4.88	5.03	5.17	
3.0	7.29	7.79	6.22	6.52	6.85	7.14	7.79	5.86	6.03	6.20	
4.2	10.20	10.90	8.70	9.13	9.58	10.00	10.90	8.20	8.44	8.68	

 $^{^{\}star}$ The rated voltage U_{r} of the arrester coincides with the continuous operating voltage U_{c} .

Housing


U _c	Creepage	Flashover distance	Height	Weight	Insulation withstand voltage of empty housing				
Continuous	distance				1.2/50 µs		1 min wet		
operating					required values guaranteed		required values guaranteed		
voltage					acc. to EN		acc. to EN		
kV DC	mm	mm	mm	kg	kV_peak	kV _{peak}	kV DC	kV DC	
0.14	232	120	90	≤ 2.0	0.50	95	0.34	30	
0.29	232	120	90	≤ 2.0	1.03	95	0.70	30	
0.36	232	120	90	≤ 2.0	1.27	95	0.86	30	
0.49	232	120	90	≤ 2.0	1.72	95	1.17	30	
0.56	232	120	90	≤ 2.0	1.97	95	1.34	30	
0.85	232	120	90	≤ 2.0	2.99	95	2.03	30	
1.0	232	120	90	≤ 2.0	3.50	95	2.38	30	
1.5	232	120	90	≤ 2.0	5.25	95	3.57	30	
2.0	232	120	90	≤ 2.0	7.00	95	4.76	30	
2.5	232	120	90	≤ 2.0	8.75	95	5.95	30	
3.0	232	120	90	≤ 2.0	10.50	95	7.14	30	
4.2	232	120	90	≤ 2.0	14.70	95	10.00	30	


Dimensions (mm)



Dimensions according to outline drawing 1HC0050941 Outline drawings with accessories on request

Structure of type designation






Structure of type designation with optional accessories (Example)

POLIM-H 1.5 SD / 1215 / 2216

Type of surge arrester ______


Type of top accessory (optional) ______


Type of bottom accessory (optional) ______



Common Top Accessories (optional)

Dimensions (mm)

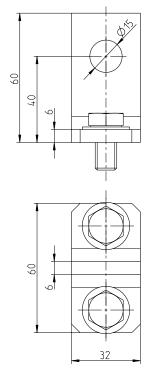





Type 1215 Flat terminal (aluminium alloy)

Common Bottom Accessories (optional)

Dimensions (mm)

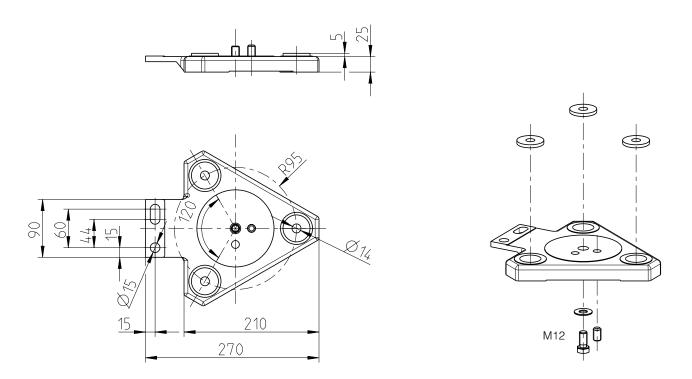

Type 2216 3-points reinforced base R = 95 - (aluminium alloy)

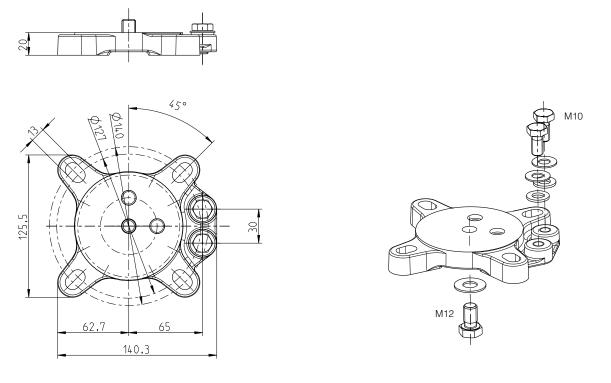



Type 2149 4-points reinforced base (aluminium alloy)

Common Bottom Accessories (optional)

Dimensions (mm)



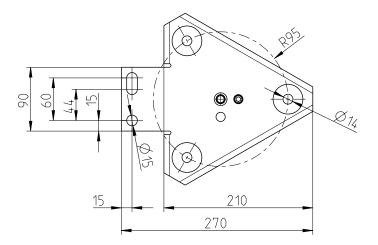



Type 2223 3-points base R = 95 (hot-dip galvanized steel)

For further information please contact:

ABB Switzerland Ltd High Voltage Products

Surge Arresters
Jurastrasse 45
CH-5430 Wettingen/Switzerland

Tel. +41 58 585 29 11 Fax +41 58 585 55 70 E-mail: sales.sa@ch.abb.com

www.abb.com/arrestersonline

For detailed information regarding the dimensioning of our products see the following ABB documents:

- Application guidelines
 Overvoltage protection
 Metal oxide surge arresters in medium voltage systems
- Application guidelines
 Overvoltage protection
 Metal oxide surge arresters in railway facilities

For pdf or print version please send E-mail to: sales.sa@ch.abb.com

Note

We reserve the right to make technical changes or modify the contents of this document without prior notice. With regard to purchase orders the agreed particulars shall prevail. ABB AG does not accept any responsibility whatsoever for potential errors or possible lack of information in this document. We reserve all rights in this document and in the subject matter and illustrations contained therein. Any reproduction, disclosure to third parties or utilization of its contents – in whole or in parts – is forbidden without prior written consent of ABB AG.

Copyright © 2016 ABB All rights reserved

Our products are certified according ISO 9001, 14001, 18001 and IRIS

