



EN 60903 : 2003

IEC 60903 : 2002



(\*) Add the size :

9 = size 9,

10 = size 10, 11 = size 11

### FIELD OF USE

- Personal protection against electrical shocks for live working from 500 to 36000V.
- These gloves have to be used with leather over gloves, to ensure a mechanical protection.
- The use of thin cotton under gloves is recommended for a better comfort and a good hygiene.


### CARACTERISTICS

- In conformity with IEC 60903.
- Insulating gloves, class 00 (500 V) to class 4 (36000V)
- Material : natural latex
- Color: beige
- This shape will ensure good ergonomics and a good sensitivity.
- RC Category : resistant to acid, ozone, oil and very low temperature
- Gloves marking following IEC 60903
- With an Instruction for use


### RANGE

Reference	Size	Category	Voltage máx (V)		Weight (g)
			AC	DC	
GP-00-*	00	AZC	500	750	90
GP-0-*	0	RC	1 000	1 500	200
GP-1-*	1	RC	7 500	11 250	270
GP-2-*	2	RC	17 000	25 500	450
GP-3-*	3	RC	26 500	39 750	560
GP-4-*	4	RC	36 000	54 000	800

### MARKING

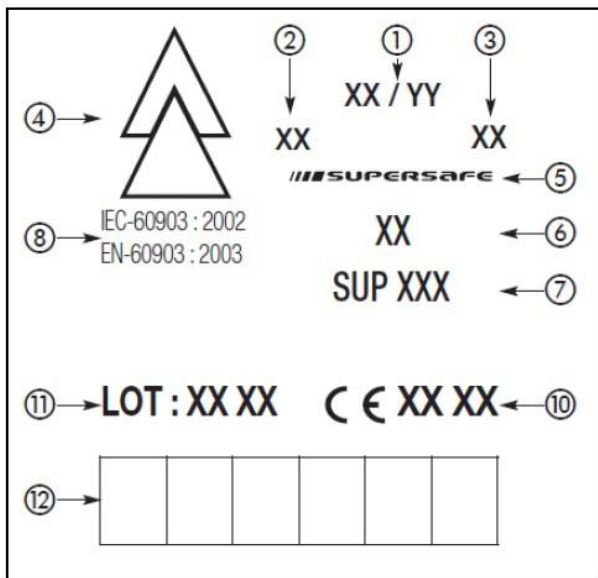

- 1.- CLASS/CATEGORY
- 2.- MONTH OF MANUFACTURE
- 3.- YEAR OF MANUFACTURE
- 4.- DOUBLE TRIANGLE FOR LIVE WORKING
- 5.- BRAND
- 6.- SIZE
- 7.- CE REFERENCE
- 8.- STANDARDS
- 9.- PRODUCT REFERENCE
- 10.- CE MARK
- 11.- TRACEABILITY
- 12.- AREA TO MARK THE DATE OF THE 1<sup>ST</sup> USE OR RETEST

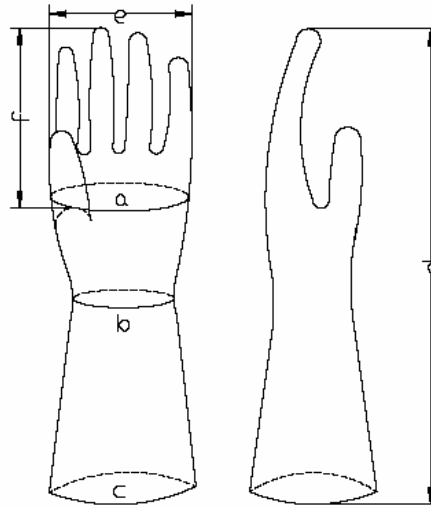

DIMENSIONS (mm)								
Reference	Size	a	b	c	d	e	f	Thickness max
GP-00-9	9	235	230	340	360	100	110	1,10
GP-00-10	10	255	240	350	360	110	115	1,10
GP-0-9	9	235	230	340	360	100	110	1,60
GP-0-10	10	255	240	350	360	110	115	1,60
GP-1-9	9	235	230	340	360	100	110	2,10
GP-1-10	10	255	240	350	360	110	115	2,10
GP-2-9	9	235	230	340	360	100	110	2,90
GP-2-10	10	255	240	350	360	110	115	2,90
GP-3-9	9	235	230	340	360	100	110	3,50
GP-3-10	10	255	240	350	360	110	115	3,50
GP-3-11	11	280	255	360	360	125	120	3,50
GP-4-10	10	255	240	350	410	110	115	4,20
GP-4-11	11	280	255	360	410	125	120	4,20

### RECOMMANDATIONS (annex E IEC 60903)

- Examination before use: Each time before use, both gloves of a pair should be visually inspected and subjected to a manually applied air test, where practicable. If either glove is thought to be unsafe, the pair should not be used and should be returned for testing.
- Storage: Gloves should be stored in their container or package. Care should be taken to ensure that gloves are not compressed, folded or stored in proximity to steam pipes, radiators or other sources of artificial heat or exposed to direct sunlight, artificial light or other source of ozone. It is desirable that the ambient temperature be between 10°C and 21°C.
- Periodic inspection: no gloves, not even those held in storage, should be used unless they have been tested within a maximum period of six months. The tests consist of air inflation to check for air leaks, a visual inspection while pressurized, and then a routine dielectric test, in accordance with IEC 60903.
- The test of the 1<sup>st</sup> use, and the controls dates, have to be marked on the gloves.

### ACCESSORIES

- CG-981: Overgloves. Sizes: 00 y 0
- CG-991: Overgloves. Sizes: 1,2,3 and 4.
- CG-37 : Fire-resistant gloves
- CG-117 : Pneumatic gloves tester
- CG-36 : Carrying bag
- CG-35 : Metal box.
- CG-35P: Plastic box

Approved by: DCA

